

# Island County Water Well Information



**WellKey: GDU**

## General Information

Owner Name (log): Chinook / Waldorf School

DOE Tag: AGA516

DOE NOI:

DOE ID

**75816**

Well Address: 3722 Cambell Dr (from parcel address


Well Parcel: **R32922-064-3430**

Served Parcel:

Horiz/Vert Accuracy: GPS / DEM

Site Type: Well

SWI Rating: Low Risk

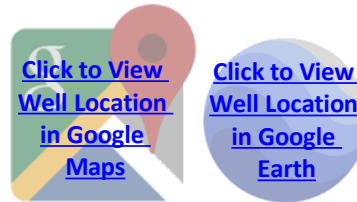

## Construction Information

Construction Date: 05/01/88

Driller Name: Well Done Drillers


LS Elevation: 425 ft. MSL

Depth Well: 235.5 ft.

TD Elevation: 190 ft. MSL

WL Measurements: **3 measurements (Click to View)**

WL Elevation: 223 ft. MSL

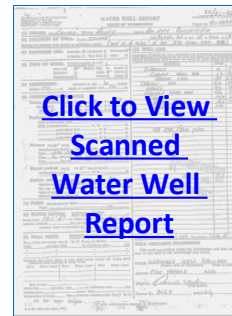

## Water Quality Information

Water Samples: **25 samples (Click to View)**


Avg/Med/Max Arsenic: 0.003 / 0.0015 / 0.005 mg/l

Avg/Med/Max Chloride: 8.44 / 10 / 10 mg/l

Avg/Med/Max Hardness: 92.50 / 82 / 130 mg/l

Avg/Med/Max Nitrate: 0.19 / 0.25 / 0.25 mg/l

Bacteria Samps (distribution): **299 samples (Click to View)**

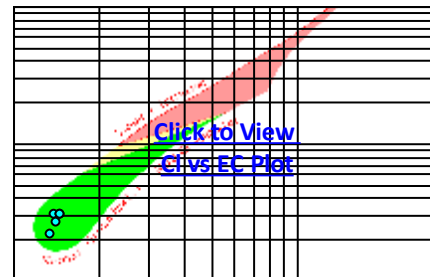

## Public Water System Information


Pws Name: Whidbey Institute

PwsID: **05235**

Approved Connects: 5

Pws Source #: SO# 1

Pws Source Name: Well #1 AGA516

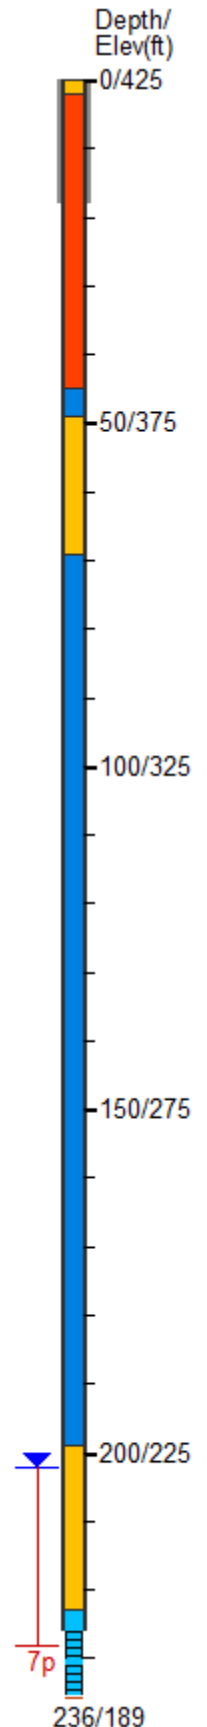

Note: Underlined items in **bright blue** are hyperlinks to additional information / resources.  
Questions? Contact the **Island County Hydrogeologist**, or visit the **Hydrogeology Web Page**.

Report Generated: 1/19/2021